

## UNIT NOTES

1. ALL DIMENSIONS ON UNIT PLANS ARE TO OUTSIDE FACE OF STUD OR CHU UNLESS NOTED OTHERWISE. STUDS NOT DIMENSIONED ARE 9 1/2" WOOD STUDS TYPICAL UNLESS NOTED OTHERWISE.
2. ALL DIMENSIONS ARE BASED ON 5/8" GYPSUM BOARD AT ALL INTERIOR BEARING AND NON-BEARING PARTITIONS.
3. KITCHEN BASE CABINETS ARE 24" DEEP AND BATH BASE CABINETS ARE 21" DEEP, TYP.
4. CLOSET SHELVES ARE MDF SHELVES W/ INTEGRAL ROD. 18 IS ONE SHELF MOUNTED AT 64" AFF. 25 IS TWO SHELVES AT 42" AND 84" AFF. 55 IS FIVE SHELVES AT 24", 40", 56", 72", AND 88" AFF. SHELVES AT UTILITY CLOSETS ARE MDF SHELVES. 25/16 IS TWO SHELVES, 16 WIDE, MOUNTED AT 60" AND 84" AFF. 55/16 IS A VERTICAL SHOE RACK BENEATH A SHELF.
5. SHELVES AT PANTRY AND LINEN CLOSETS ARE MDF SHELVES. 55/16 IS FIVE SHELVES, 16" WIDE, MOUNTED AT 24", 40", 56", 72", AND 88" AFF.
6. VERIFY EXACT DIMENSIONS REQUIRED TO INSTALL HVAC AND WATER HEATING EQUIPMENT WITH MANUFACTURER BEFORE BUILDING ENCLOSURE WALLS AND FURR DOWNS.
7. VERIFY FRAMING OPENING DIMENSIONS SHOWN FOR TUBS AND SHOWERS WITH ACTUAL TUB AND SHOWER SUPPLIER. ADJUST AS REQUIRED.
8. CEMENTIOUS BACKER BOARD SHALL BE USED AT ALL TUB/SHOWER AREAS. MOISTURE RESISTANT GYPSUM BOARD WILL NOT BE ACCEPTED AT THESE LOCATIONS.
9. ALL INTERIOR UNIT WALLS AND CEILINGS ARE PAINTED 1" GYP. BOARD UNLESS NOTED OTHERWISE.
10. ALL INTERIOR UNIT WALLS TO HAVE PAINTED WOOD BASE TRIM INCLUDING MECHANICAL UTILITY 1" GYP. CLOSETS.
11. UNLESS NOTED OTHERWISE ALL CEILING HEIGHTS APPROX. 8'-0" UNLESS NOTED OTHERWISE.
12. UNLESS NOTED OTHERWISE, SHADED AREA [Hatched] INDICATES THE LOCATION OF FURR-DOWNS AT 7/8" TYPICAL.
13. REFER TO PROJECT DATA SHEET FOR PROJECT SQUARE FOOTAGE INFORMATION.
14. FOR WALL TYPES REFER TO SHEETS 2009-2004.
15. ALL WORK AND CONSTRUCTION SHALL MEET OR EXCEED ALL APPLICABLE CODES.
16. MOUNTING HEIGHT FOR TOWEL BAR INSIDE SHOWER IS 5'-0" A.F.F.
17. MOUNTING HEIGHT FOR TOWEL BAR NOT INSIDE SHOWER AND NOT ABOVE TOILET, IS 4'-0" A.F.F. MOUNTING HEIGHT FOR T.P.H. IS 30" A.F.F.
18. ALL INTERIOR ELEVATIONS ARE DRAWN ASSUMING FINISH FACE OF GYPSUM BOARD U.N.O.
19. PROVIDE FINISH PANELS AT ALL EXPOSED END CONDITIONS OF CABINETS AND WHERE DISHWASHER DOES NOT HAVE AN ADJACENT CABINET.
20. PROVIDE BLOCKING TO ACCOMMODATE 42" UPPER CABINETS AT KITCHEN.
21. INSULATE ALL PLUMBING RISERS IN WALL WITH BATT INSULATION.
22. FOR ACCESSIBILITY REQUIREMENTS REGARDING ACCESSIBLE ROUTES AND PROTRUDING ELEMENTS, REFER TO A120 AND ANSI 111.1 2008 FOR MORE INFORMATION.
23. FOR ACCESSIBILITY REQUIREMENTS REGARDING USABLE AND ACCESSIBLE DOORWAYS, REFER TO A120 AND ANSI 111.1 2008 FOR MORE INFORMATION.
24. FOR ACCESSIBILITY REQUIREMENTS REGARDING THRESHOLDS, REFER TO A120 AND ANSI 111.1 2008 FOR MORE INFORMATION.
25. FOR ACCESSIBILITY REQUIREMENTS REGARDING THE PRIMARY AND SECONDARY ENTRANCE DOORS, REFER TO A120 AND ANSI 111.1 2008 FOR MORE INFORMATION.
26. FOR ACCESSIBILITY REQUIREMENTS REGARDING SWITCHES, OUTLETS AND CONTROLS, REFER TO A120 AND ANSI 111.1 2008 FOR MORE INFORMATION.
27. FOR ACCESSIBILITY REQUIREMENTS REGARDING REINFORCING AROUND TOILETS, TUBS AND SHOWERS, REFER TO A120 AND ANSI 111.1 2008 FOR MORE INFORMATION.
28. FOR ACCESSIBILITY REQUIREMENTS REGARDING TYPE A 1 TYPE B BATHROOMS, AND POWDER ROOMS, REFER TO A120 AND ANSI 111.1 2008 FOR MORE INFORMATION.
29. FOR ACCESSIBILITY REQUIREMENTS REGARDING HANDICAPS AND CLEAR FLOOR SPACES, REFER TO A120 AND ANSI 111.1 2008 FOR MORE INFORMATION.
30. FOR ACCESSIBILITY REQUIREMENTS REGARDING CLEARANCE AT BATHROOM FIXTURES, REFER TO A120 AND ANSI 111.1 2008 FOR MORE INFORMATION.
31. FOR ACCESSIBILITY REQUIREMENTS REGARDING CLEARANCE AT KITCHEN AREAS, REFER TO A120 AND ANSI 111.1 2008 FOR MORE INFORMATION.
32. MOUNTING ELEVATION FOR IPDD DOGS STATION IS 3'-6" AFF.

LIGHT FIXTURE  
CENTERED ON MIRROR  
AND SINK AT 7'-0" AFF.

SHOWER ROD  
SHOWER HEAD  
PIPE AT 6'-6"  
A.F.F.

CERAMIC TILE  
TO CLS.












10 INTERIOR ELEVATION  
1/4" = 1'-0"

11 INTERIOR ELEVATION  
1/4" = 1'-0"

12 INTERIOR ELEVATION  
1/4" = 1'-0"

13 INTERIOR ELEVATION  
1/4" = 1'-0"

14 INTERIOR ELEVATION  
1/4" = 1'-0"

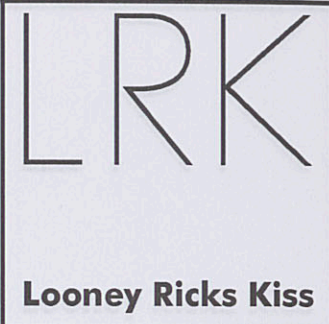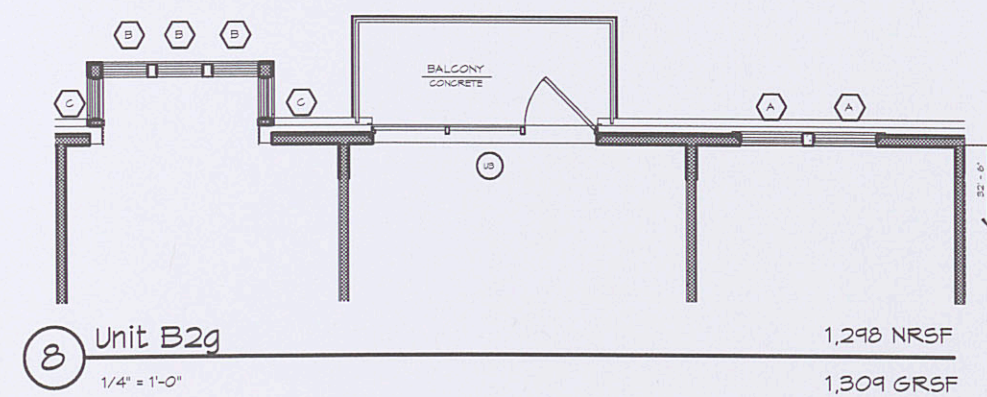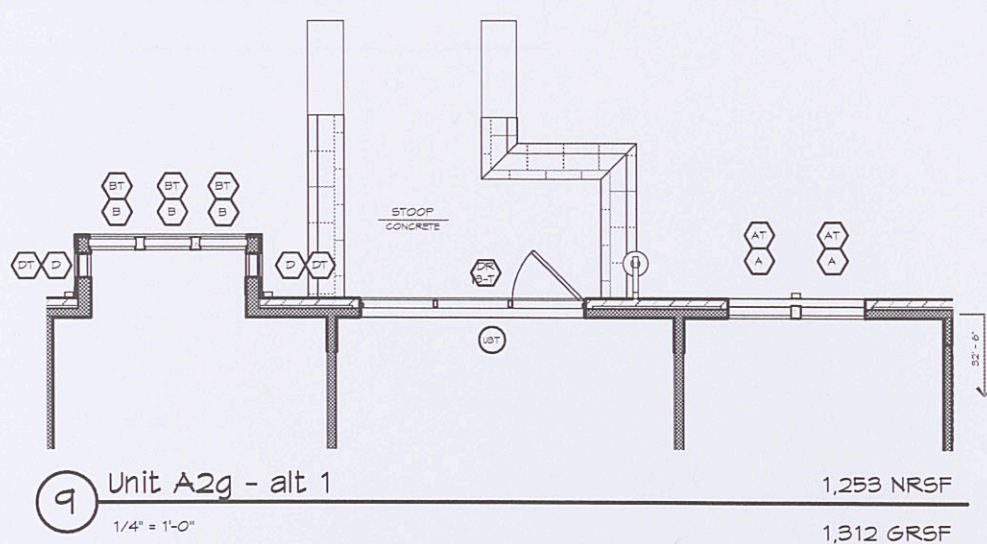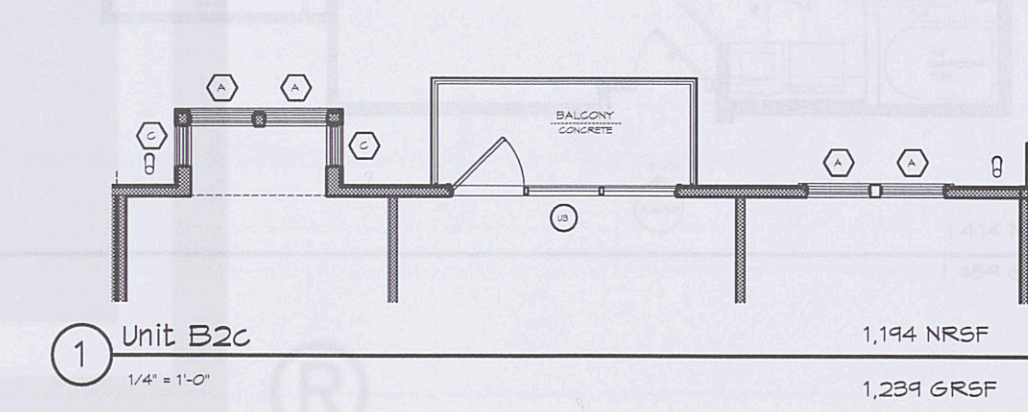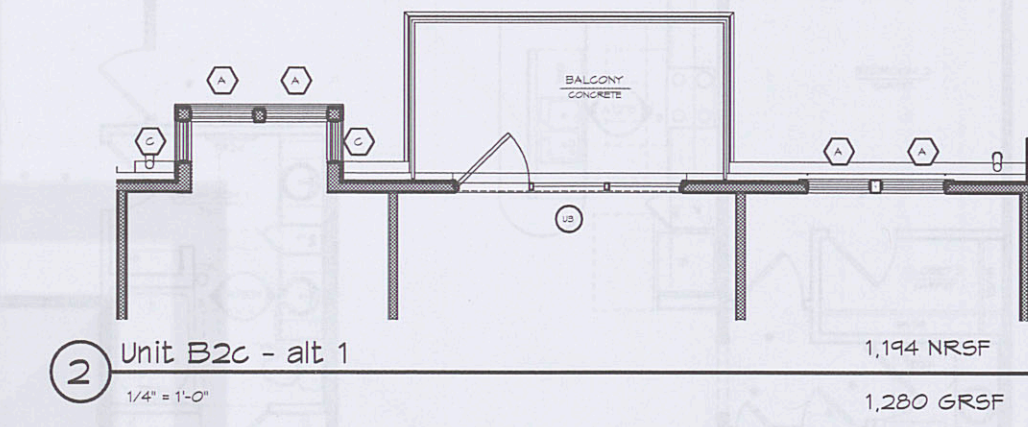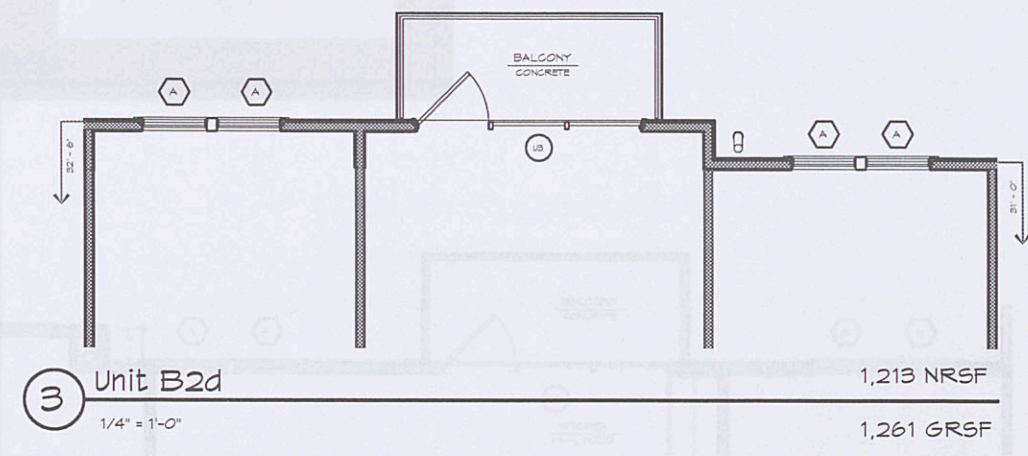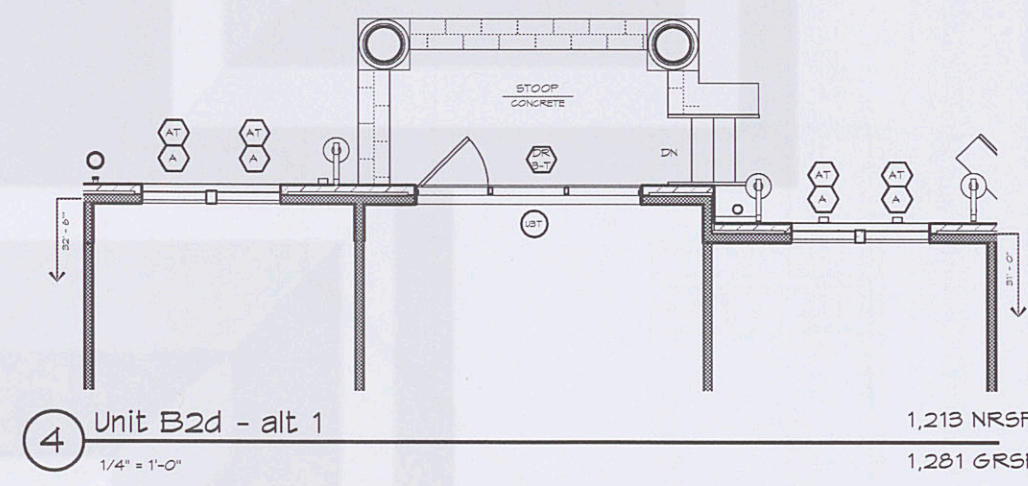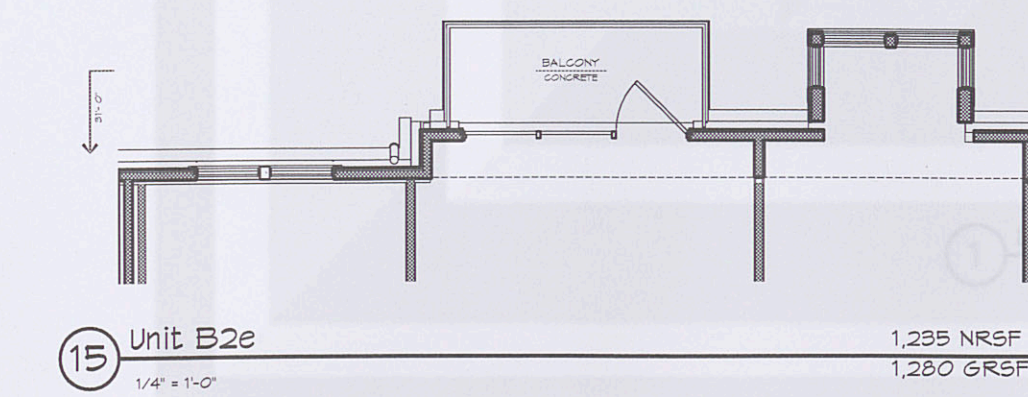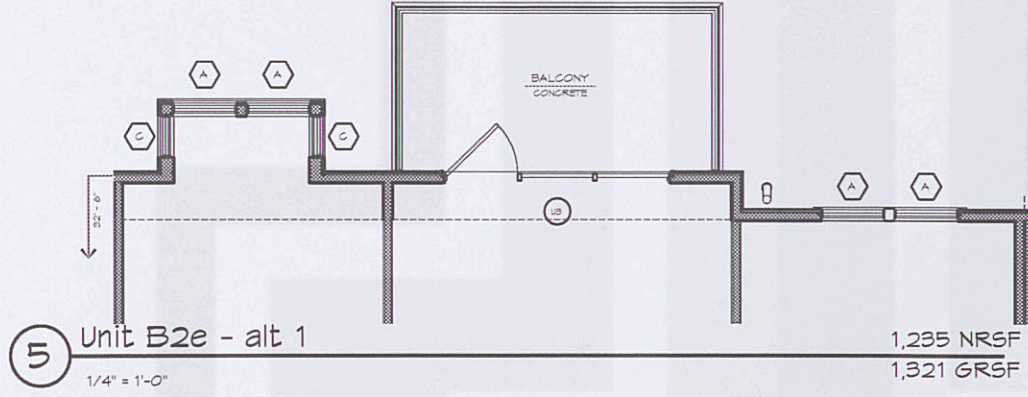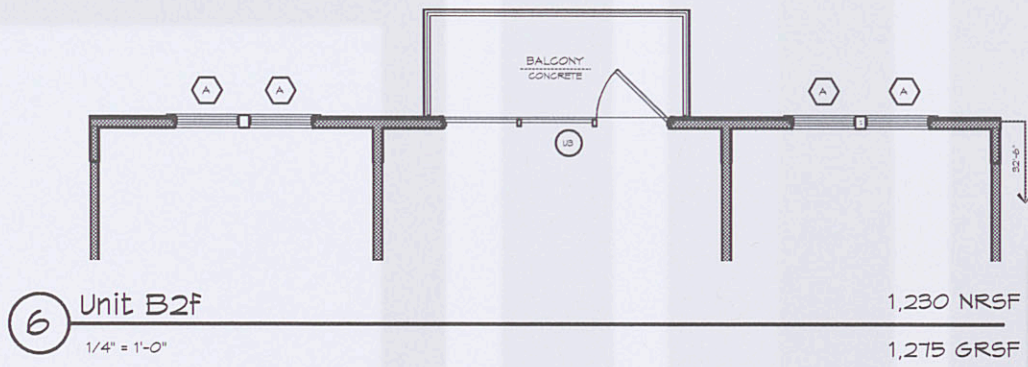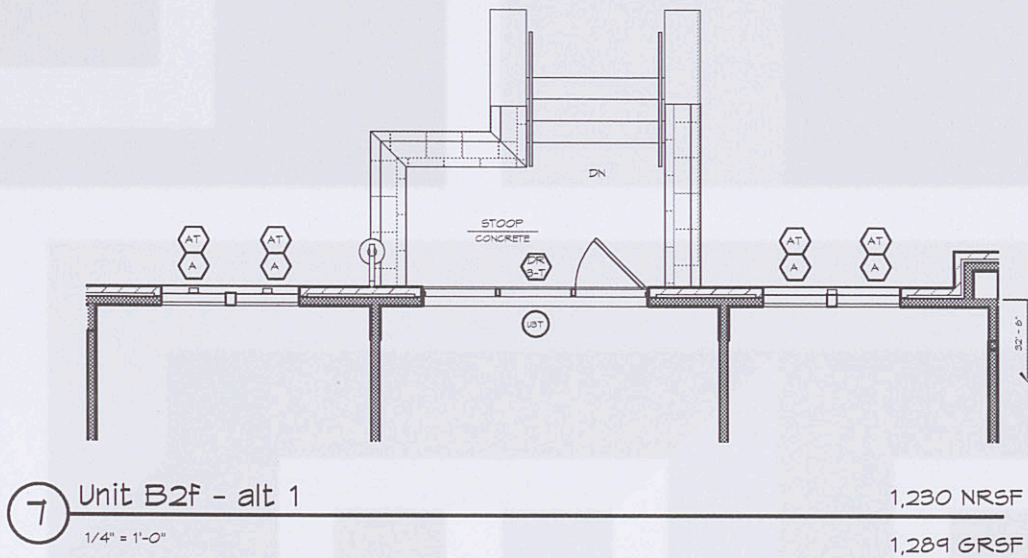

Architecture Planning Interiors Research  
175 Toyota Plaza, Suite 600  
Memphis, Tennessee 38103  
Telephone 901.521.1440  
Fax 901.525.2760  
E-mail info@lrk.com

Client:  
**LOADSTAR, Inc.**  
9830 Colonnade Boulevard, Suite 600  
San Antonio, Texas 78230

Date	Issues
12.16.11	50% Design Development
01.27.12	Design Development
04.03.12	50% CD
06.08.12	PRICING SET
07.11.12	PERMIT SET

No.	Date	Revisions
A	07/11/12	Addendum One
B	10/15/12	For Construction Set

©2012 LRK Inc.  
Drawings, written material, and design concepts shall not be used or reproduced in whole or part in any form or format without prior written consent of LRK Inc. Do not scale drawings. Use given dimensions only. If not shown, verify correct dimensions with the Architect. Contractor shall check and verify all dimensions and conditions at job site.

Seal



Project Number: 01.110730.00

Project Name:

La Cantera Mixed Use

6215 Via La Cantera  
San Antonio, Texas 78256

Drawing Name:

Unit B2

Drawn By: BD, MF, DS

Checked By: BD, BE

A127a